


ZSB-409A Wiring Diagram for Migatron's RPS-409A-IS, RPS-409A-IS2 & RPS-409A-IS3 Ultrasonic Sensors

ZSB-409A, RPS-409A-IS, RPS-409A-IS2 & RPS-409A-IS3 must be installed in accordance with the appropriate Control Drawing(s).

Note: This Safety Barrier has been tested extensively by Migatron for defects. Failure to wire the safety barrier correctly may cause failure of the safety fuse(s). Fuse failures will not be covered under standard warranty terms.

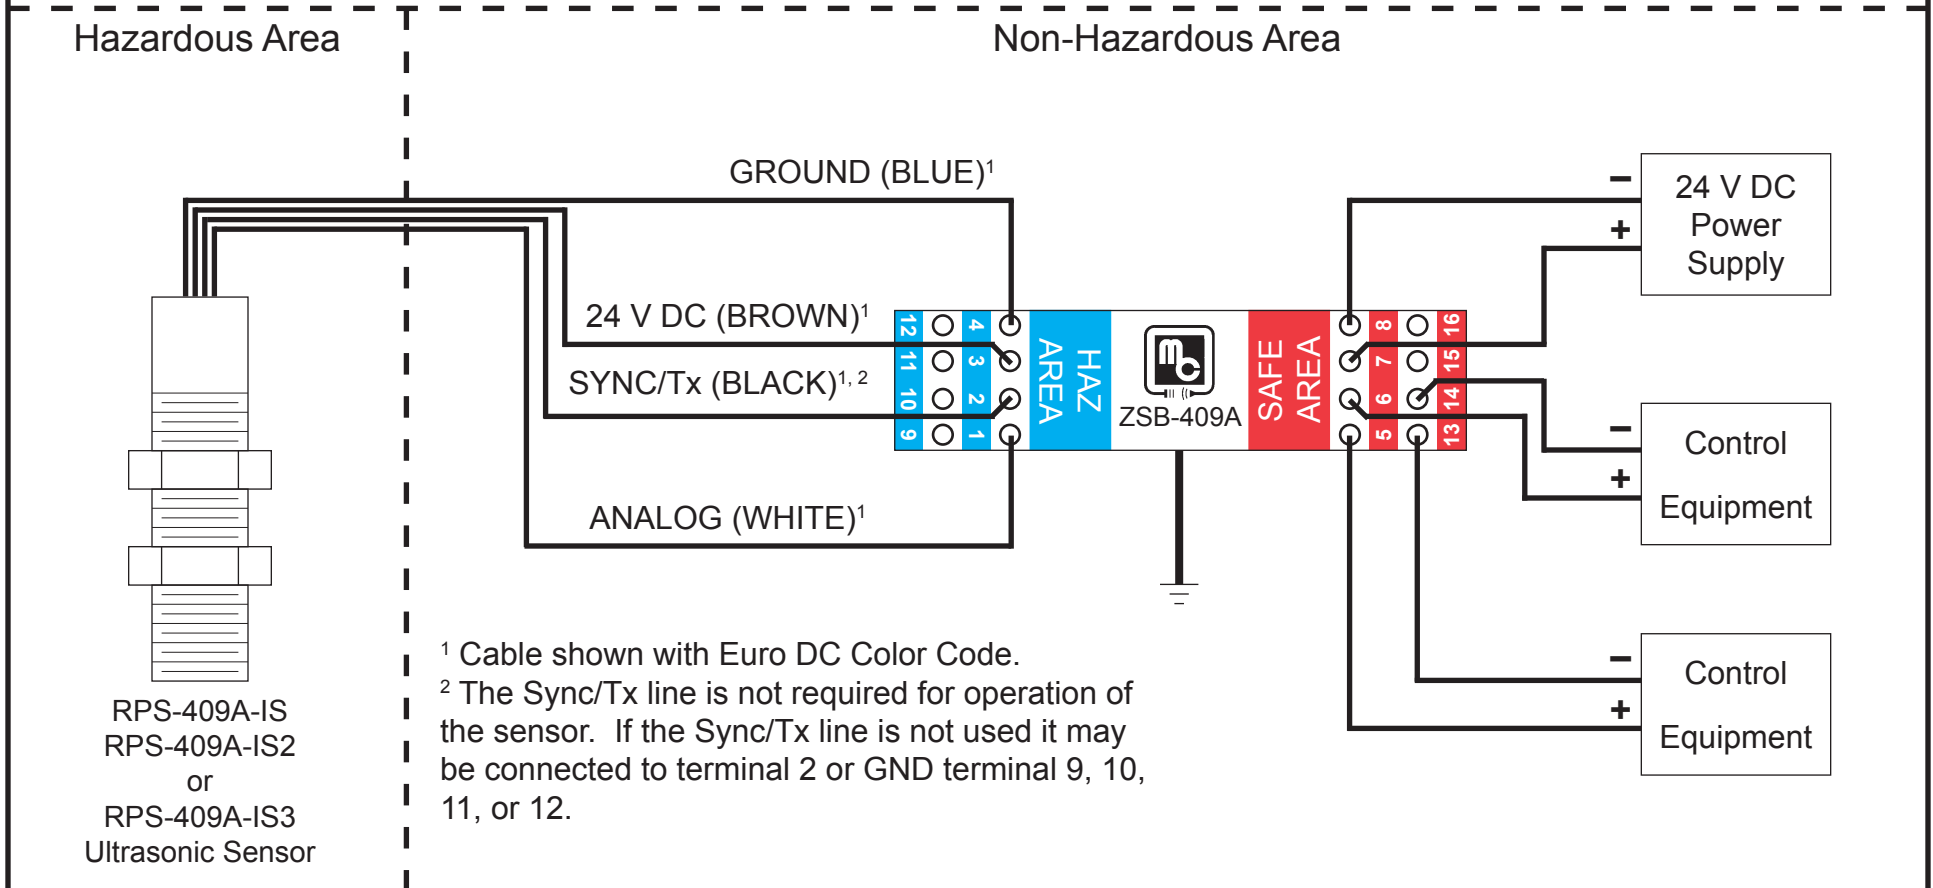

Rev	Drawing Date	Description	Approved By	Approval Date	Effective Date	Drawn By/Date	Migatron Corporation 935 Dieckman Street Woodstock, IL 60098 USA Title: ZSB-409A Wiring Diagram		
1	03-20-2014	Initial Release	J.V.V.	03-21-2014	03-21-2014	JVV/03-20-2014			
2	11-06-2015	Add RPS-409A-IS3	J.V.V.	11-06-2015	11-06-2015		Scale: N/A	Date: November 6, 2015	Page 1 of 1